
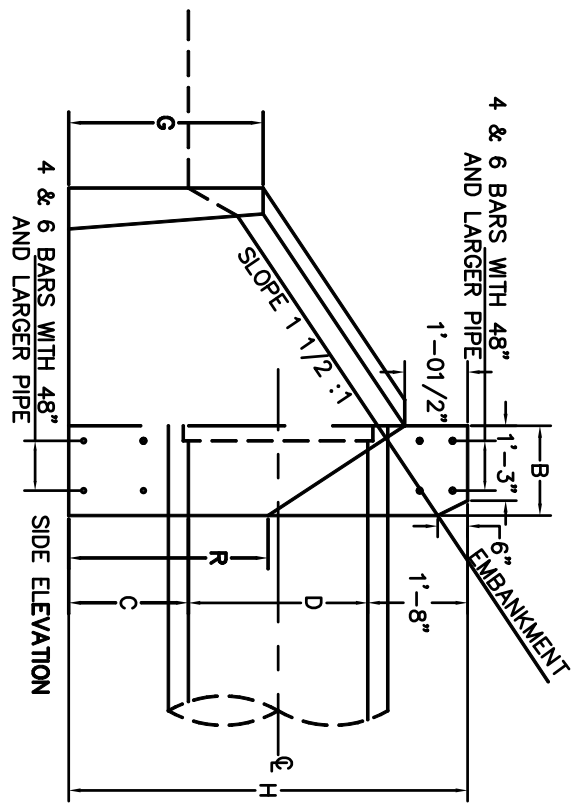
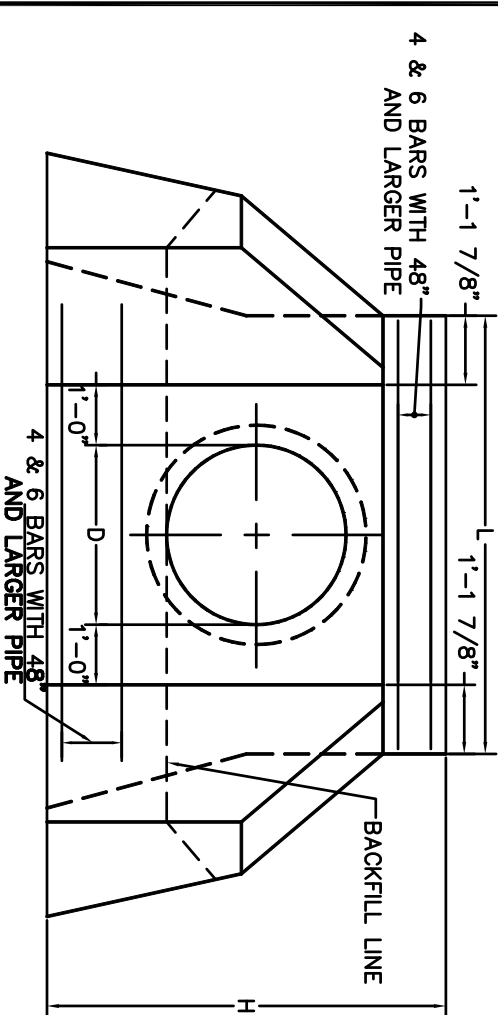


DIMENSIONS AND QUANTITIES FOR ONE WING TYPE ENDWALL													
D	B	C	G	H	K	L	P	Q	R	W	VOL.		
INS.	FT. INS.	FT. INS.	FT. INS.	FT. INS.	FT. INS.	FT. INS.	FT. INS.	FT. INS.	FT. INS.	FT. INS.	CU YDS		
36"	1'-6"	2'-0"	3'-3"	6'-8"	9'-1 1/2"	7'-3 3/4"	1'-4 7/8"	0'-9 3/4"	3'-4 7/8"	4'-1 3/8"	5.17		
42"	1'-6"	2'-0"	3'-3"	7'-2"	9'-10 1/2"	7'-9 3/4"	1'-6 3/8"	0'-9 3/4"	3'-10 1/2"	4'-11 3/4"	5.75		
48"	1'-7"	2'-6"	3'-9"	8'-2"	10'-10"	8'-3 3/4"	1'-9 3/8"	0'-11 1/4"	4'-9"	5'-10"	7.78		
54"	1'-7"	2'-6"	3'-9"	8'-8"	11'-7 1/2"	8'-9 3/4"	1'-10 7/8"	0'-11 1/4"	5'-3"	6'-8 1/2"	8.51		
60"	1'-7"	2'-6"	3'-9"	9'-2"	12'-4 1/2"	9'-3 3/4"	2'-0 3/8"	0'-11 1/4"	5'-9"	7'-7"	10.46		
72"	1'-7"	2'-6"	3'-9"	10'-2"	13'-10 3/4"	10'-3 3/4"	2'-3 3/8"	0'-11 1/4"	6'-9"	9'-3 3/4"	13.56		

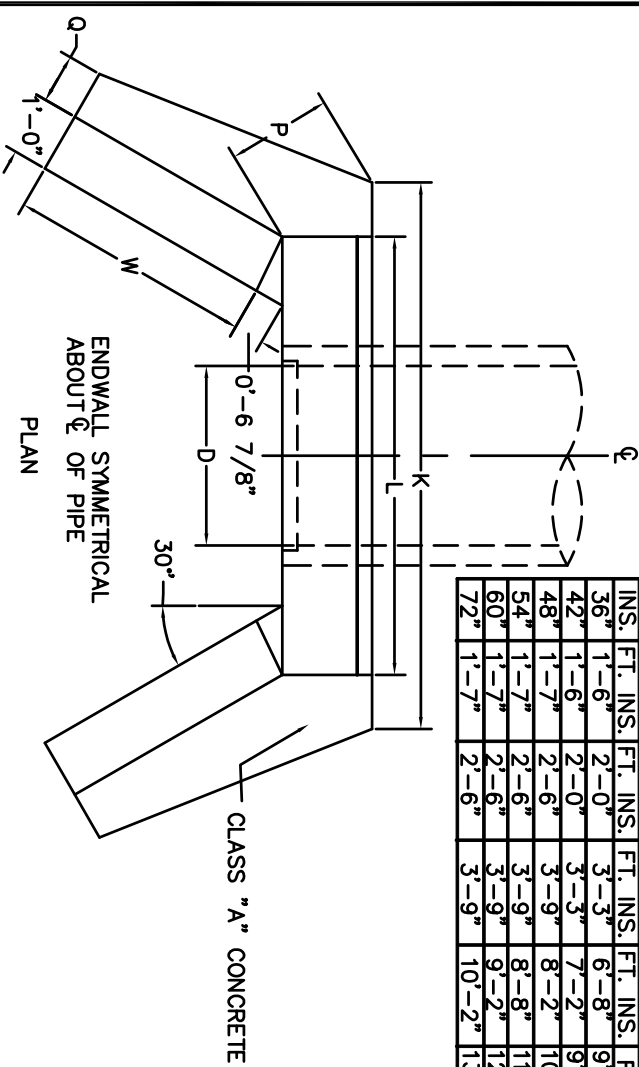

NOTE:
WHEN ONE ENDWALL IS TO BE USED FOR TWO PIPES, THE DIMENSIONS OF THE ENDWALL SHALL CONFORM TO THOSE REQUIREMENTS FOR THE LARGER PIPES, EXCEPT THE DIMENSION "L" SHALL BE INCREASED BY THE OUTSIDE DIAMETER OF THE SMALLER PIPE PLUS TWO FEET.

SECTION 4.11

SCALE		CITY OF TORRINGTON <i>Engineering Department</i>
T.S.		
Approved		
E.J.F.		
RV. DATE		
JAN. 2002		WING TYPE ENDWALL
JUL. 2010		
AUG. 2011		