


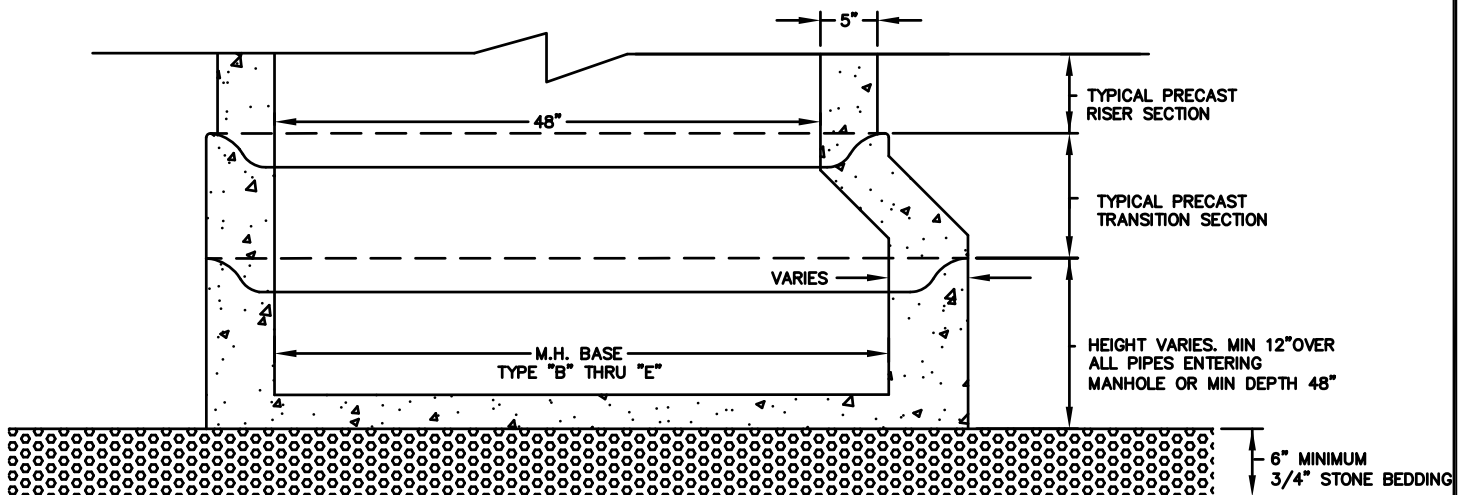

NOTE:
ALL STRUCTURES SHALL BE SET ON A MINIMUM DEPTH OF 6" OF 3/4" (NO.6) CRUSHED STONE BEDDING

SCALE
N.T.S.
APPROVED
E.J.F.
RV. DATE
JAN. 2002
JUL. 2010
AUG. 2011

CITY OF TORRINGTON
Engineering Department

PRE-CAST STORM
MANHOLE BASE