


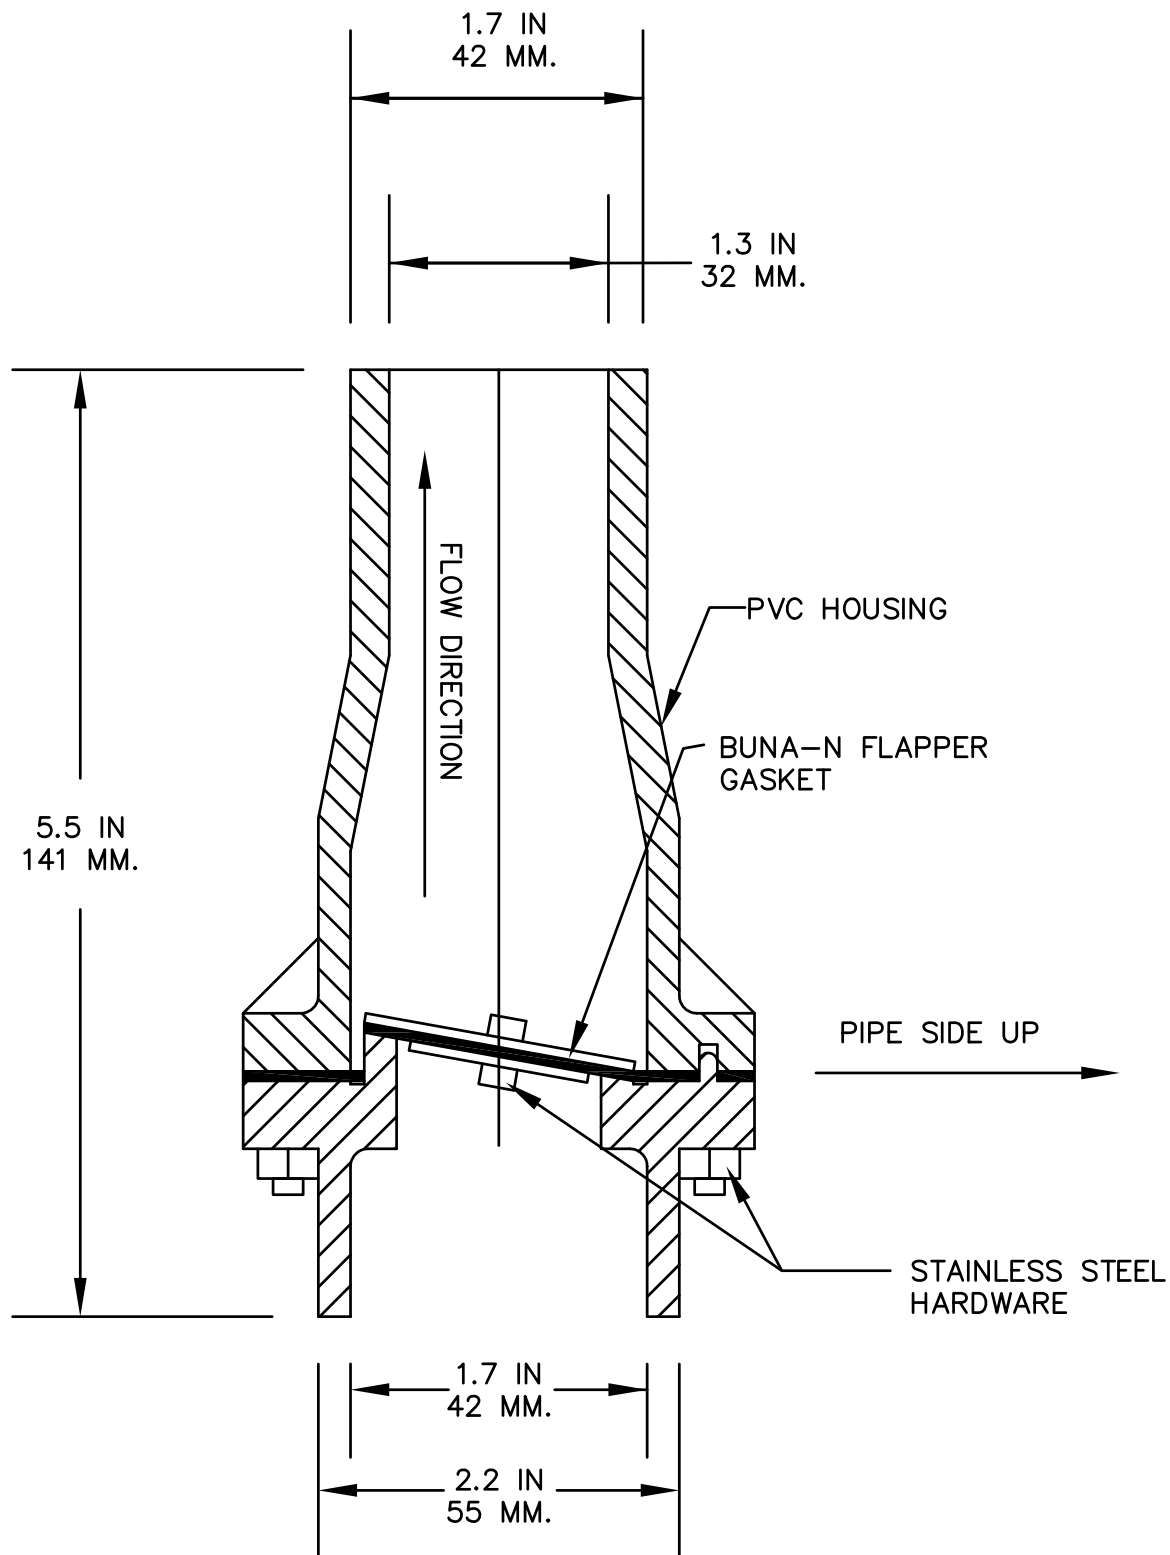

NOTE: INSTALLATION OF A CHECK VALVE IS REQUIRED IN EACH 1.25" LATERAL BETWEEN THE CURB STOP AND THE GRINDER PUMP.

SECTION 5.21

SCALE N.T.S.	CITY OF TORRINGTON Engineering Department
APPROVED E.J.F	
RV. DATE	LOW PRESSURE SANITARY SEWER REDUNDANT CHECK VALVE
JAN. 2002	
JUL. 2010	
AUG. 2011	